

The reproduction, distribution and utilization of this document as well as the communication of its contents to others without explicit authorization is prohibited.

Weitergabe sowie Vervielfältigung dieses Dokuments, Verwertung und Mitteilung seines Inhalts sind verboten, soweit nicht ausdrücklich erlaubt.

2-Wire Transmitter Stratos Pro Type A201X-*-0-T6 (intrinsically safe apparatus)

Hazardous Classified Area

Unclassified Area

IECEX Ex ib [ja Ga] IIC T6 Gb or
Ex ia IIC T6 Ga or
Ex ib [ja Da] IIIC T60°C Db

ATEX II 2(1)G Ex ib [ja Ga] IIC T6 Gb or
II 1G Ex ia IIC T6 Ga or
II 2(1)D Ex ib [ja Da] IIIC T60°C Db


Ambient temperature
-20 °C ≤ Ta ≤ +50 °C

RS 485 interface
(InduCon/Memosens)
Terminals 1, 2, 3, 4

MK interface ST 15
for Module MK-***X

Current input
Terminals 5, 6

Terminals 12, 15, 16, 17, 18
not connected

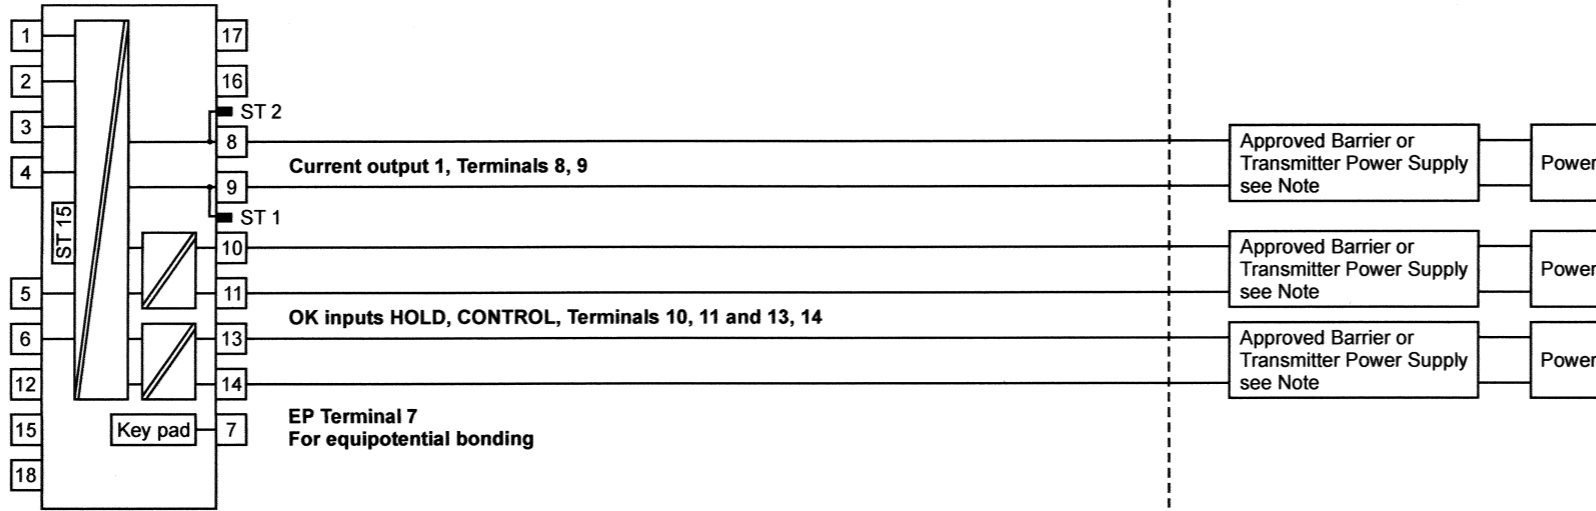

	Type of protection intrinsic safety Ex ia or Ex ib with the following maximum values													
	Ui, Vmax (V)	Ii, Imax (mA)	Pi, Pmax (mW)	Ci (μF)	Li (μH)									
Current output 1 / HART (Terminals 8, 9, ST1, ST2)	30	100	800	5.3	2.5									
Current input (Terminals 5, 6)	30	100	800	12	0									
OK input HOLD (Terminals 10, 11)	30	100	1000	0	0									
OK input CONTROL (Terminals 13, 14)	30	100	1000	0	0									
	Type of protection intrinsic safety Ex ia with the following maximum values													
	IIC, IIB or IIA			IIC			IIB			IIA			IIC, IIB, and IIA	
Explosive dust atmosphere														
IIC														
Uo, Voc (V)	Io, Isc (mA)	Po (mW)	Co, Ca (μF)	Lo, La (mH)	Co, Ca (μF)	Lo, La (mH)	Co, Ca (μF)	Lo, La (mH)	Co, Ca (μF)	Lo, La (mH)	Ci (μF)	Li (μH)		
RS 485 (InduCon/Memosens) (Terminals 1, 2, 3, 4) Linear characteristic	5	124	155	83.2	2	1000	8.5	1000	16	10.7	1.2			
MK interface	Only for connection to a measuring module MK-***X belonging to Stratos® Pro Type A... System													
EP (Terminal 7)	For equipotential bonding													

Simultaneous connection of a measuring module MK-... and an InduCon/Memosens measuring system is not permitted.

IS Safe galvanic isolation up to 60 V

WARNING - SUBSTITUTION OF COMPONENTS MAY IMPAIR INTRINSIC SAFETY

WARNING - DO NOT SEPARATE MODULE WHEN ENERGIZED

Notes

- Control equipment connected to the associated apparatus must not use or generate more than 250 V.
- At the time of installation mark the selected type of protection on the equipment marking.

				Zul. Abweichungen für Maße ohne Toleranzangabe		Maßstab	
						Zulassung IECEX: KEM 08.0020 ATEX: KEMA 08 ATEX 0100	
				Datum		Name	
				28.05.2008		dam	
				Geprüft (KB)		21.1.22 R.P.	
				Freigabe		21.1.22 R.P.	
4	Normenanpassung	11.01.22	kmn	Schutzvermerk nach ISO16016 beachten.			
3	A201B entfernt	26.07.21	dam				
2	page 7	22.09.15	dam				
1	Zulassungstexte	31.01.13	dam				
Nr.	Änderungen	Datum	Bearb.	Freigabe	Elektronische Messgeräte GmbH & Co. KG		
						Benennung	
						Control Drawing Stratos Pro A201X-*-0-T6	
						Zeichnungsnummer	
						212.002-100	
						Blatt	
						5	
						Bl.	

Knick >